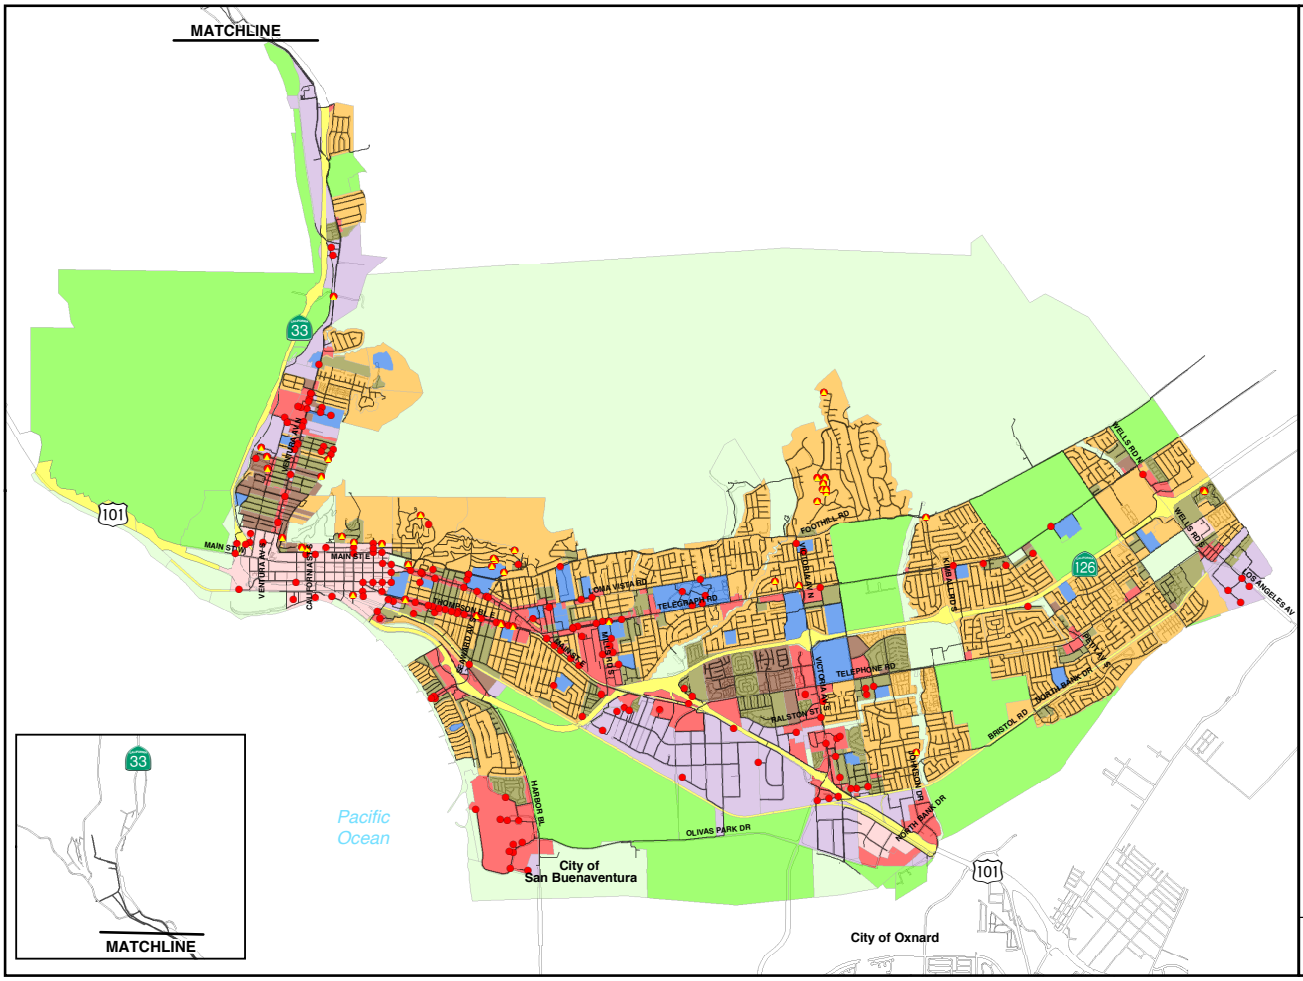

CITY OF SAN BUENAVENTURA

Deficient Fire Flow Locations

Legend

- Locations with Residual Pressure less than 20 PSI
- Locations with Available Fire Flows less than 1,000 GPM
- Pipelines

Landuse

- Agriculture
- Commerce
- Industry
- Neighborhood Low
- Neighborhood Medium
- Neighborhood High
- Public and Institutional
- Park and Open Space
- Right of Way
- Specific Plan

Notes:
1. Deficient locations indentified under maximum day demands plus applicable fire flow requirement based on landuse.

0 0.45 0.9 Miles

Source: City of San Buenaventura 2005 General Plan

RBF CONSULTING GIS

Exhibit XII-1

M:\Mdata\Dianetemp\EXXII_1_DeficientFHLoc_L11x17.mxd 12/05/2007 -- DR